




CITY OF
COLUMBIA
TENNESSEE

SINGLE GRATE CURRB INLETT
(NTS)



DATE
4-23-2012

DWG. NO.
DD-01

SECTION A-A

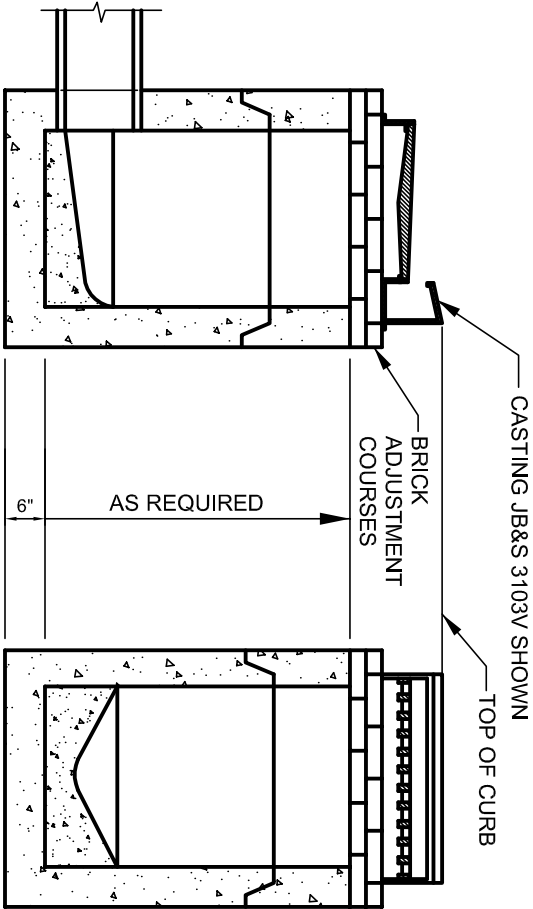

SECTION B-B

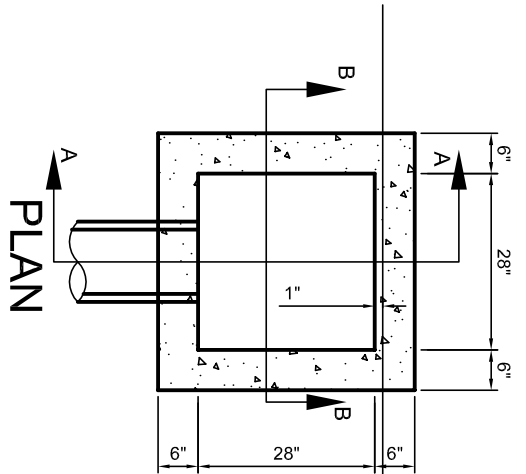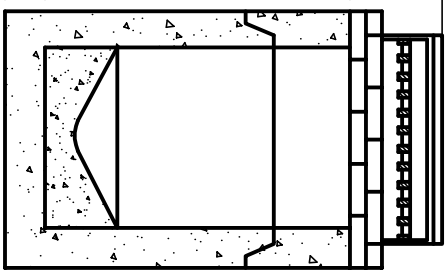

- NOTES:
1. USE J.B. #3300V FOR 30" CURRB & GUTTER AND J.B. #3103V FOR EXTRUDED CURRB.
 2. CONCRETE TO BE 4000 psi AT 28 DAYS.
 3. REINFORCE WITH NO. 4 BARS GRADE 60.