




CITY OF
COLUMBIA
TENNESSEE

CONCRETE ENDWALL


(NTS)

DATE
4-23-2012
DWG. NO.
DD-04

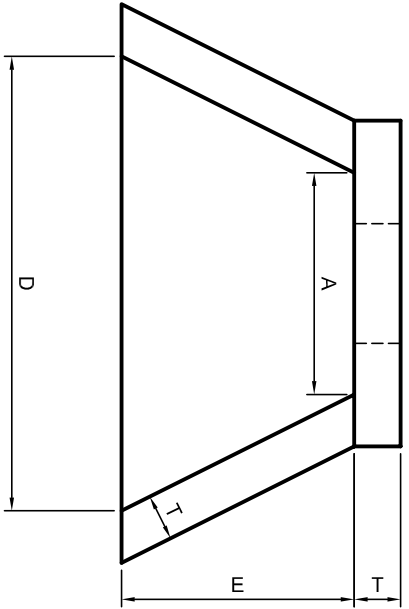


PLAN

TABLE OF DIMENSIONS					
PIPE SIZES	A	D	E	F	T (MIN)
15"	2'-6"	5'-0"	2'-6"	1'-9"	6"
18"	2'-6"	5'-0"	2'-6"	1'-9"	6"
21"	2'-6"	5'-0"	2'-6"	1'-9"	6"
24"	4'-0"	6'-6"	3'-6"	3'-3"	6"
30"	4'-0"	6'-6"	3'-6"	3'-3"	6"
36"	5'-6"	8'-0"	3'-6"	4'-5"	6"
42"	5'-6"	8'-0"	4'-0"	4'-5"	6"
48"	5'-6"	8'-0"	4'-0"	4'-5"	6"

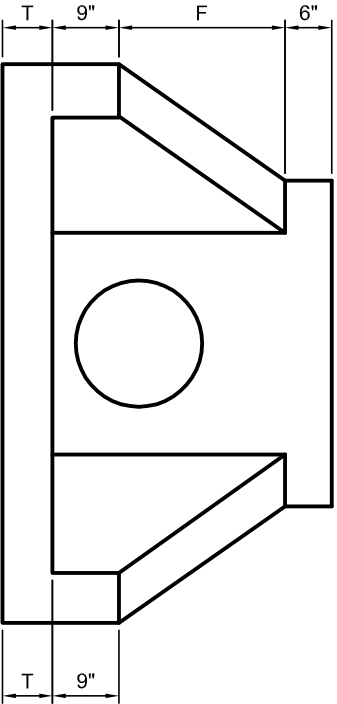

FRONT ELEVATION

CONCRETE: 4000 PSI AT 28 DAYS
REINFORCED WITH NO. 4 BARS 10" C-C EACH WAY WITH WINGS
AND TOE SLAB DOWELLED TO HEADWALL WITH NO. 5 BARS
3/4" CHAMFER ON ALL EXPOSED EDGES

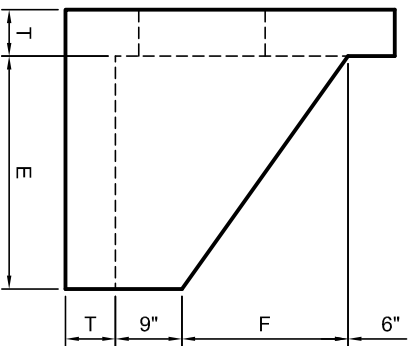

SIDE ELEVATION