



CITY OF
COLUMBIA
TENNESSEE


AREA DRAIN

(NTS)

DD-03


DWG. NO.

DATE
4-23-2012

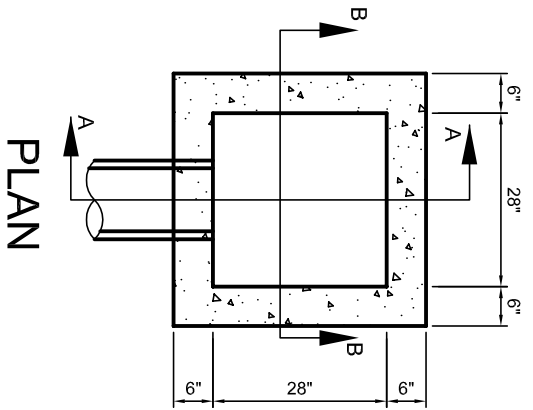

PLAN

- NOTES:
1. CASTING SHALL BE JOHN BOUCHARD 4330 FRAME AND 4220 GRATE OR APPROVED EQUIVALENT.
 2. CONCRETE TO BE 4000 psi AT 28 DAYS.
 3. REINFORCE WITH NO. 4 BARS GRADE 60.

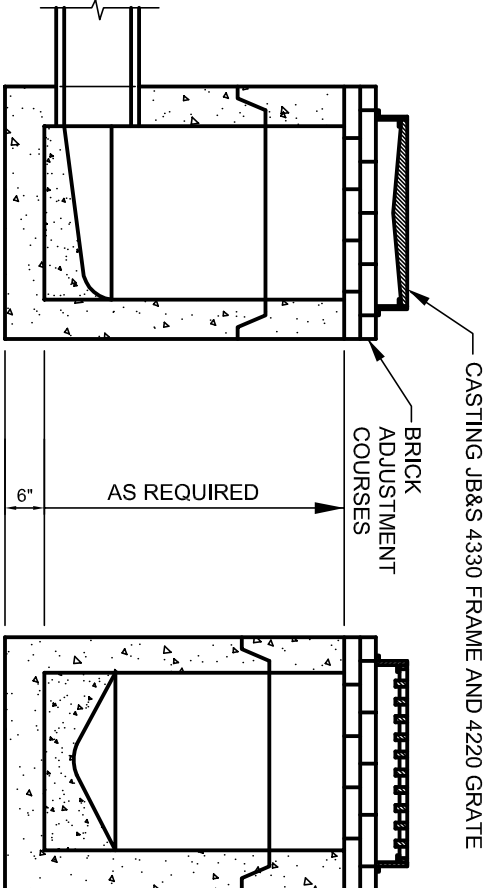

SECTION A-A

SECTION B-B

BRICK
ADJUSTMENT
COURSES

CASTING JB&S 4330 FRAME AND 4220 GRATE

AS REQUIRED

6"